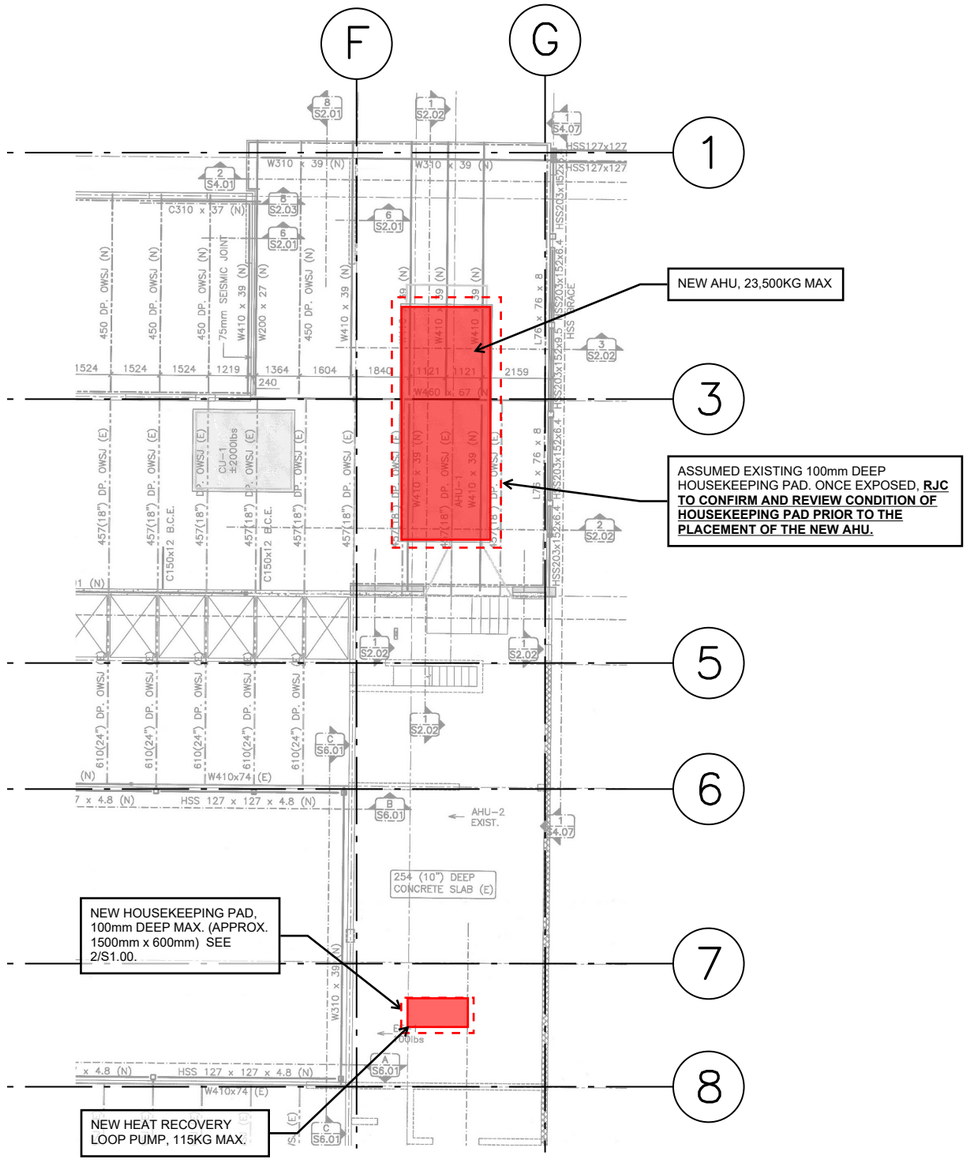

1 S1.00 **PARTIAL LOW ROOF FRAMING PLAN**
NOT TO SCALE

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR LOCATION, EXTENT, AND THICKNESS OF HOUSEKEEPING PADS.
2. THIS DETAIL PROVIDES RESISTANCE TO HORIZONTAL (SLIDING) FORCES ONLY FROM EARTHQUAKE LOADING ON PAD AND EQUIPMENT. ADDITIONAL CONNECTIONS FOR UPLIFT FORCES FROM EQUIPMENT TO BE DESIGNED AND DETAILED BY SPECIALTY ENGINEER AND WILL REQUIRE ANCHORING THROUGH THE PAD AND INTO OR THROUGH THE STRUCTURAL SLAB.



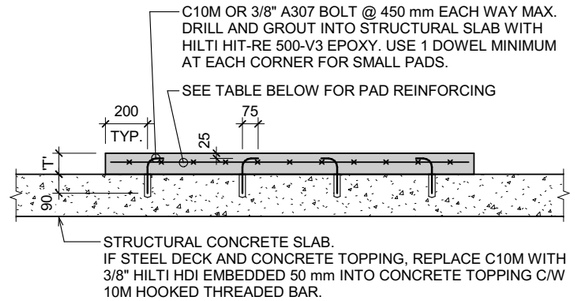

'T' (PAD THICKNESS)	REINFORCING
UP TO 100 mm	1 SHEET OF WWR 152 X 152 - MW18.7 X MW18.7 LAP 300 mm AT MID-DEPTH
110 mm TO 150 mm	10M @ 400 EACH WAY AT MID-DEPTH
160 mm TO 200 mm	10M @ 300 EACH WAY AT MID-DEPTH

2 S1.00 **HOUSEKEEPING PAD DETAIL**
NOT TO SCALE

PROFESSIONAL ENGINEER
PROVINCE OF BRITISH COLUMBIA
A. D. POST
42210
2026-06-19
EGBC Permit to Practice
No. 1002503

All drawings, plans, models, designs, specifications and other documents prepared by Read Jones Christoffersen Ltd. ("RJC") and used in connection with this project are instruments of service for the work shown in them (the "Work") and as such are and remain the property of RJC whether the Work is executed or not, and RJC reserves the copyright in them and in the Work executed from them, and they shall not be used for any other work or project.

No.	Revision	Date	By
01	Issued for Tender	2026-06-19	HL

rjc Engineers

Project Name
ESQUIMALT RECREATION CENTRE - AHU REPLACEMENT

Sketch Title
LOW ROOF PARTIAL PLAN AND NEW MECHANICAL UNIT LAYOUT

Drawn By	**HL**
Scale	**NOT TO SCALE**
Date	**2026-06-19**
Project No.	**VIC.021015.0022**
Sketch Number	**S1.00**
Rev.	**.**